


Scale	V	W	X	Y	Z
3-Tank	98"	74 1/2"	31"	10 3/4"	8 1/2"
4-Tank	132"	101 7/8"	31"	13 9/16"	8 1/2"
5-Tank	166"	129 1/2"	30"	16 1/4"	9"
6-Tank	200"	155"	26 1/2"	20"	10 3/4"

DO NOT PREPOUR ANCHOR BOLTS  
 RECOMMEND MOUNTING PADS  
 BE A MINIMUM OF 12" x 12"  
 ALL DIMENSIONS ARE CENTERLINE  
 OF FOOT.  
 USE SCALE PLATFORM  
 AS TEMPLATE FOR BOLT LOCATION  
 TO AVOID BINDING.



C.1.136  
 S.1.136  
 W.1.136

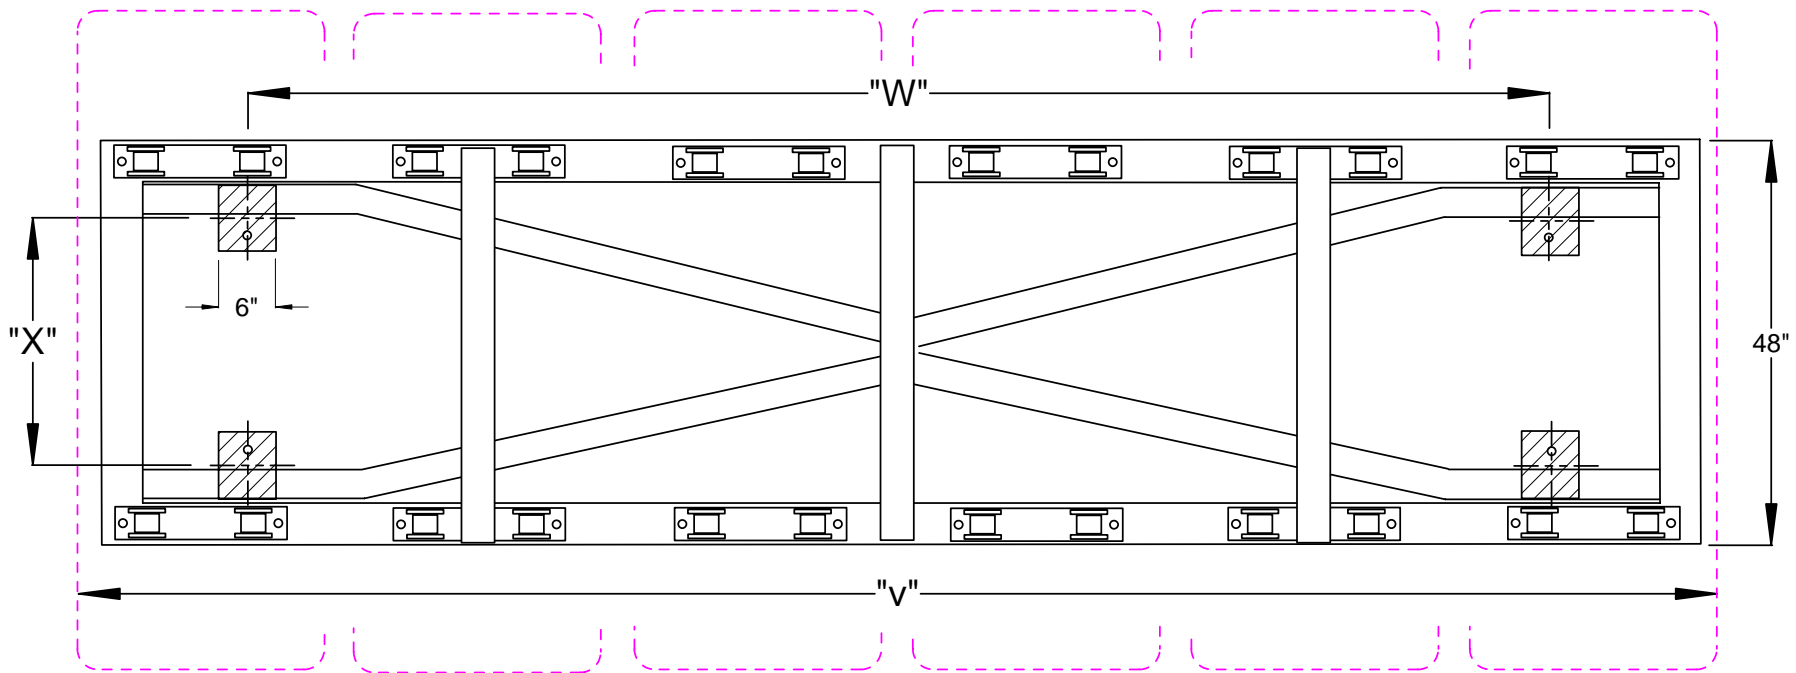

1150-D Burnett Ave, Concord, CA 94520 USA  
 1-800-893-6723 US & Canada, Fax: 925-686-6713  
 www.forceflow.com / info@forceflow.com

File: T4\O&M\TONHYD\MULT FOOT PLACEMENT.tcw (P16.pdf)  
 EMAIL: DRAWINGS/TON/MULT FOOT PLACEMENT.pdf

**INSTALLATION DRAWING  
 3- THRU 6-TANK SCALE  
 MOUNTING PLATE LOCATIONS**

Drawn by: SLJ/MD  
 Date: 09/01/95  
 Revised: 08/11/05 MD  
 Scale: NONE

Drawing Number  
**30086**  
 aka 29462